


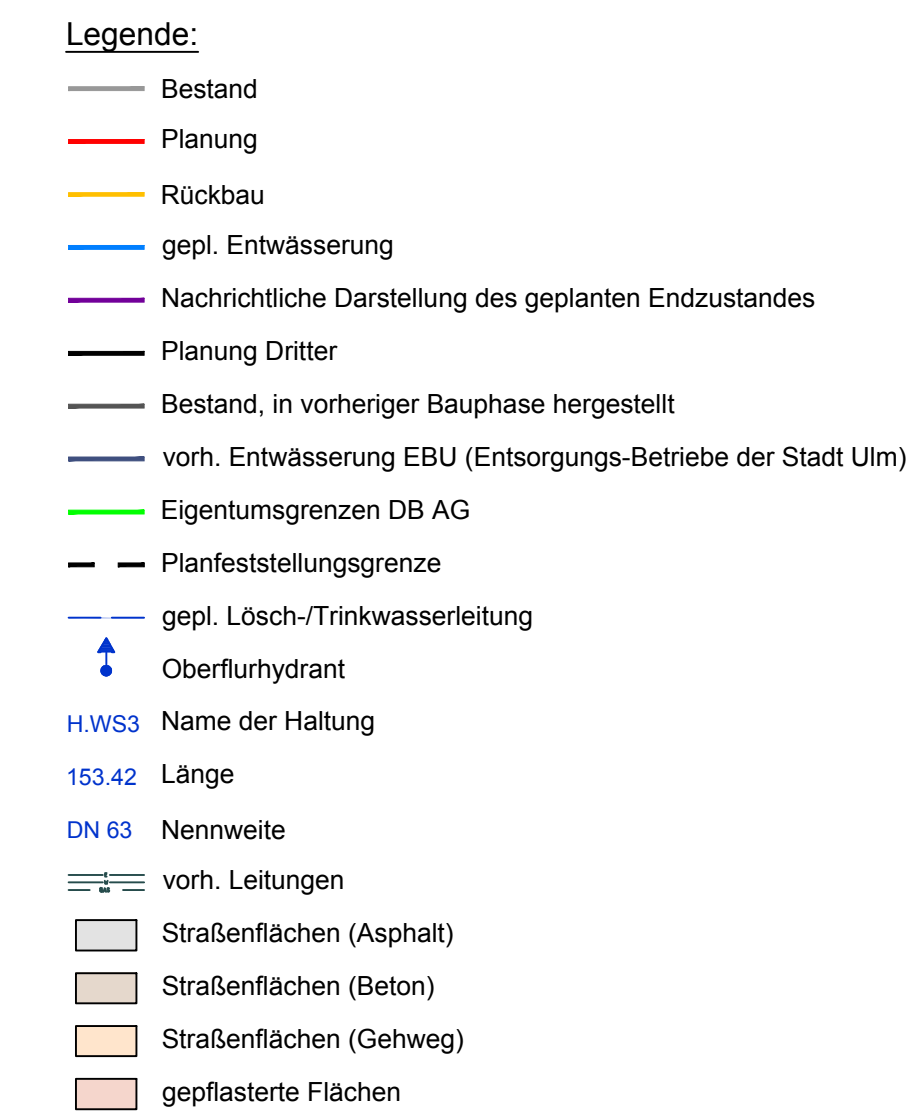

```
Val ze remote work\1-cr\03\118005807 - UDU: LPH 5-7-200 CADQ250 AP12 Entwässerung\BPH2-3\W+TW\W LP BPH 02.dwg, Bl 05, 07.07.2025 13:32:32, in/225
```